
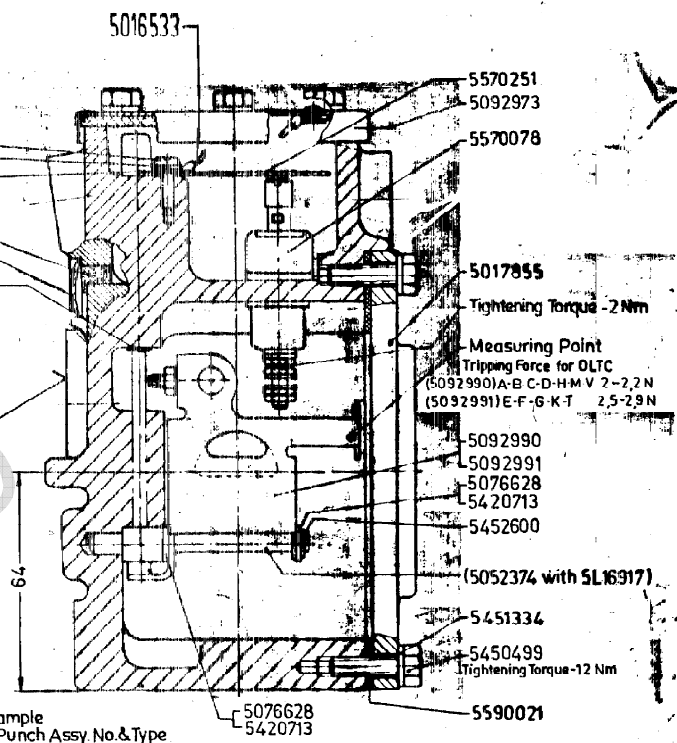
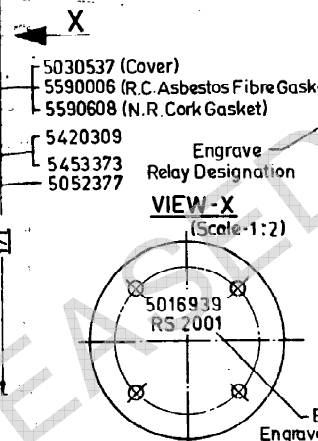


CAN. 54-83 DATE
 08
 ALTD. 28.11.2005
 APPD. 08.11.2005
 DRG. REDRAWN.
 IN NOTE SG-13005 WAS
 WINDING FOR LEAKAGE
 TEST. SG-14024 WAS FOR
 QUALITY CHECKS. INSTEAD
 OF ACCEPTANCE CRITERIA
 SG-13004 APPLIED FOR CHECKS

Stamp/Punch Earthing Mark & fill with Red Paint

NOTE :- Clearance between Crimping Terminals
 and to Housing to be minimum 5 mm.



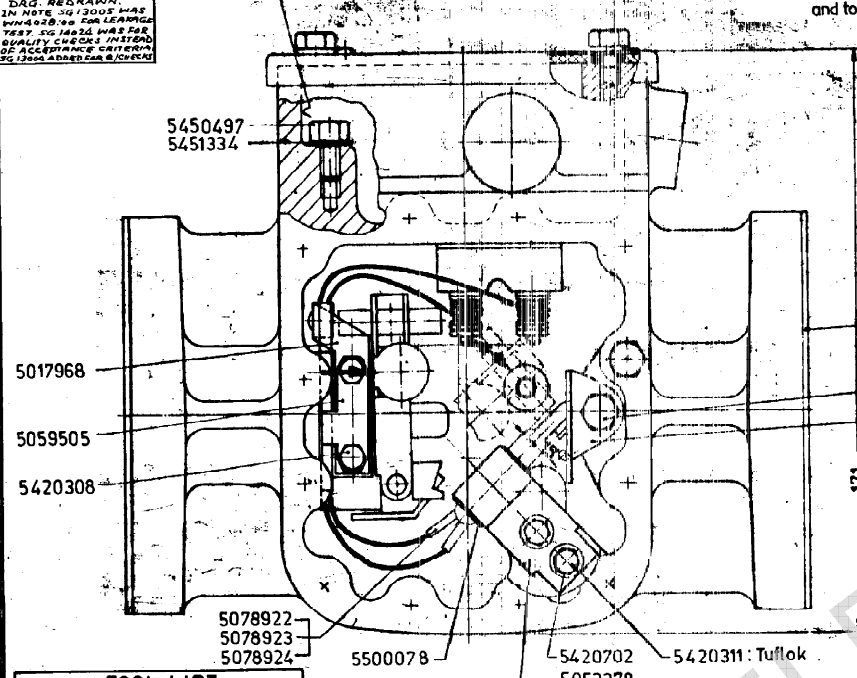


TOOL LIST

ITEM	TOOL	DESCRIPTION
-	1520259	HOLDING FIXTURE
-	1520260	FORCE MEASURING INSTRUMENT

TOP VIEW WITHOUT COVERING & COVER

TOP VIEW WITH COVERING (WITHOUT COVER)

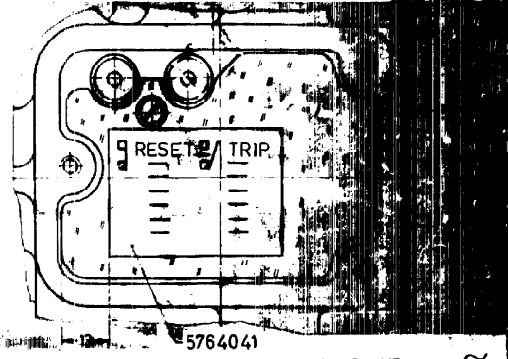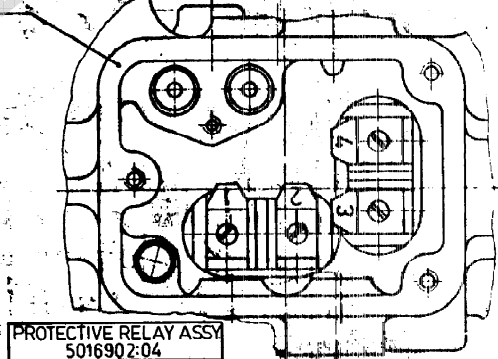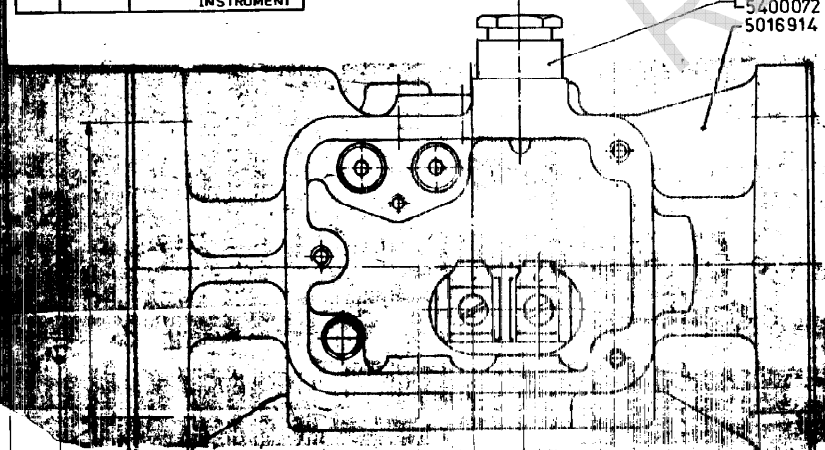

PROTECTIVE RELAY ASSY
 5016902:04

VAR	ASSEMBLY	HOUSING SUBASSY
01	5016939:04	
02	5016940:04	
03	5016941:04	5018914:03
04	5016942:04	
05	5016943:04	
06	5016944:04	5016917:03

NOTE TO SHOP:-
 Clean Outside thoroughly apply One Coat of Etch Primer AA56103 followed by Two Coats of High Quality Full Glossy Outdoor finishing AA56126 to AA 067 4111.

NOTE - REFER SG-14024 FOR ACCEPTANCE CRITERIA, SG-13004 FOR QUALITY CHECKS AND SG-13005 FOR PRESSURE TIGHTNESS/LEAKAGE TEST FREON-12 AT 0.6 BAR TEST PRESSURE.

R	19399	11.7.91	CR	11.7.91	11.7.91	TAPCHANGERS
Q	19456	11.16.94	G	11.7.91	11.7.91	CR. 300V 13.3.77
P	18276	12.16.94	F	11.7.91	11.7.91	CR. 300V 13.3.77
O	16319	18.3.89	E	11.7.91	11.7.91	CR. 300V 13.3.77
N	18227	24.11.06	D	11.7.91	11.7.91	CR. 300V 13.3.77
M	17965	27.4.88	C	11.7.91	11.7.91	CR. 300V 13.3.77
L	16304	4.5.84	B	11.7.91	11.7.91	CR. 300V 13.3.77
K	15774	18.7.83	A	11.7.91	11.7.91	CR. 300V 13.3.77
J	15293	18.6.78				CR. 300V 13.3.77
I	15157	3.1.78				CR. 300V 13.3.77

RS 2001
OIL SURGE
PROTECTIVE DEVICE
 5L16902: RZ445

PRINTS TO: BHEL-BHOPAL
 Ersatz für: Erstdurch: