



Form No. 2038

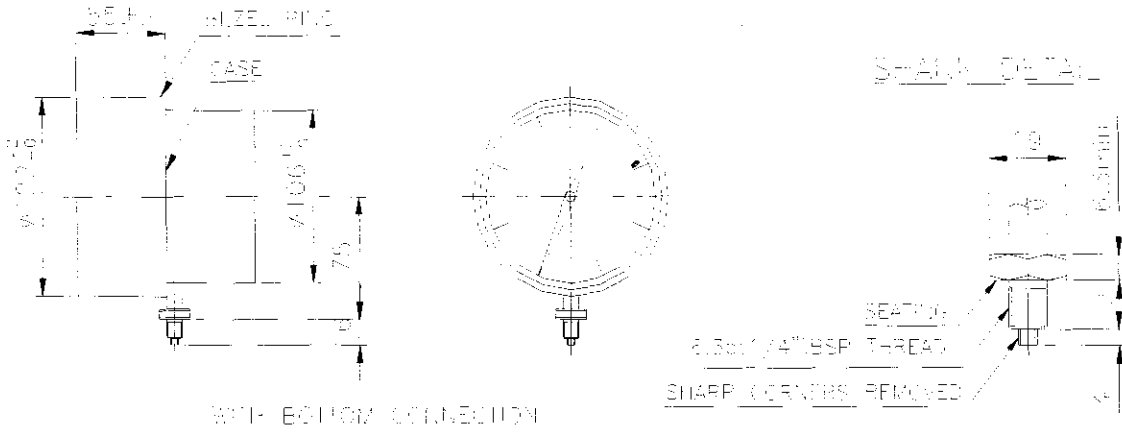
उत्पाद मानक  
परिणामित्र  
शाप/अभि. निर्देश

PRODUCT STANDARD  
TRANSFORMER  
SHOP/ENGG INSTRUCITONS

TR 20007P

1 पृष्ठों में

PAGE 1 OF 1

**TITLE -****PRESSURE GAUGE**

STYLE	<del>BP9036033608</del>	BP9036042003
TYPE	GAUGE SHALL BE SUITABLE FOR USE WITH TRANSFORMER OIL TO IS:335 AT 90°C & FOR OUTDOOR APPLICATION.	GAUGE SHALL BE SUITABLE FOR USE WITH RAW WATER AT 60°C & WITH TRANSFORMER OIL TO IS:335 AT 90°C & FOR OUTDOOR APPLICATION
NORMAL SIZE	100MM.	100MM.
PRESSURE RANGE	0-1.5 KG/CM <sup>2</sup> (0-150 kpa)	0-0.6 KG/CM <sup>2</sup> (0-60 kpa)
SCALE	CONCENTRIC, SPREAD OVER TO 270° WITH MINIMUM READABLE PRESSURE OF 0.02 KG/CM <sup>2</sup> (2 kpa)	CONCENTRIC, SPREAD OVER TO 270° WITH MINIMUM READABLE PRESSURE OF 0.01KG/CM <sup>2</sup> (1 kpa)
DIAL	ALUMINIUM, TREATED TO RESIST CORROSION & PAINTED WHITE WITH BLACK MARKINGS FOR C.G.S. UNIT (Kg/cm <sup>2</sup> )	ALUMINIUM, TREATED TO RESIST CORROSION & PAINTED WHITE WITH BLACK MARKINGS FOR C.G.S. UNIT (Kg/cm <sup>2</sup> )
MOUNTING	DIRECT MOUNTING BOTTOM CONNECTION, HAVING 1/4" BSP MALE THREADS.	DIRECT MOUNTING BOTTOM CONNECTION, HAVING 1/4" BSP MALE THREADS.
CASE & BEZEL	ANODIZED ALUMINIUM CASE, ENAMELLED BLACK & STOVED WITH ANODIZED ALUMINIUM BEZEL RING OR BRASS CASE WITH CHROMIUM PLATED BRASS BEZEL RING.	ANODIZED ALUMINIUM CASE, ENAMELLED BLACK & STOVED WITH ANODIZED ALUMINIUM BEZEL RING OR BRASS CASE WITH CHROMIUM PLATED BRASS BEZEL RING.
ACCURACY	±1% OF FULL SCALE DEFLECTION	±1% OF FULL SCALE DEFLECTION

**NOTES :-**

1. ALL GAUGES SHALL BE MARKED FOR C.G.S. UNIT (Kg.sq.cms.)
2. THE ABOVE GAUGES GENERALLY CONFORM TO IS:3624-1966.
3. THE DRAWING REPLACES DRG. C600760 (P-03).

REF COMP. Drg C600760 P-03

COPYRIGHT AND CONFIDENTIAL  
Information on this document is the property of BHARAT HEAVY ELECTRIC LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the Company.

PAGE 1 OF 1

Rev. 07  
R.  
D.  
18  
62-11

ST603360 DELETED

P.K.C. S.K.G. F.D.

वितरण  
DISTRIBUTION.  
TRE/TRM/FTM  
TRX/TTG/  
QC-TCB/QA-TCB/  
JHANSI

सं.

स्वीकृत किया :  
APPROVED : Sd /-M.CJ, SNA, SCB

तैयार किया PREPD.

Sd /-RAHTEKAR

जारी किया ISSUED  
टीआरई/मानक TRE/STD.

दिनांक  
DATE  
16.12.81